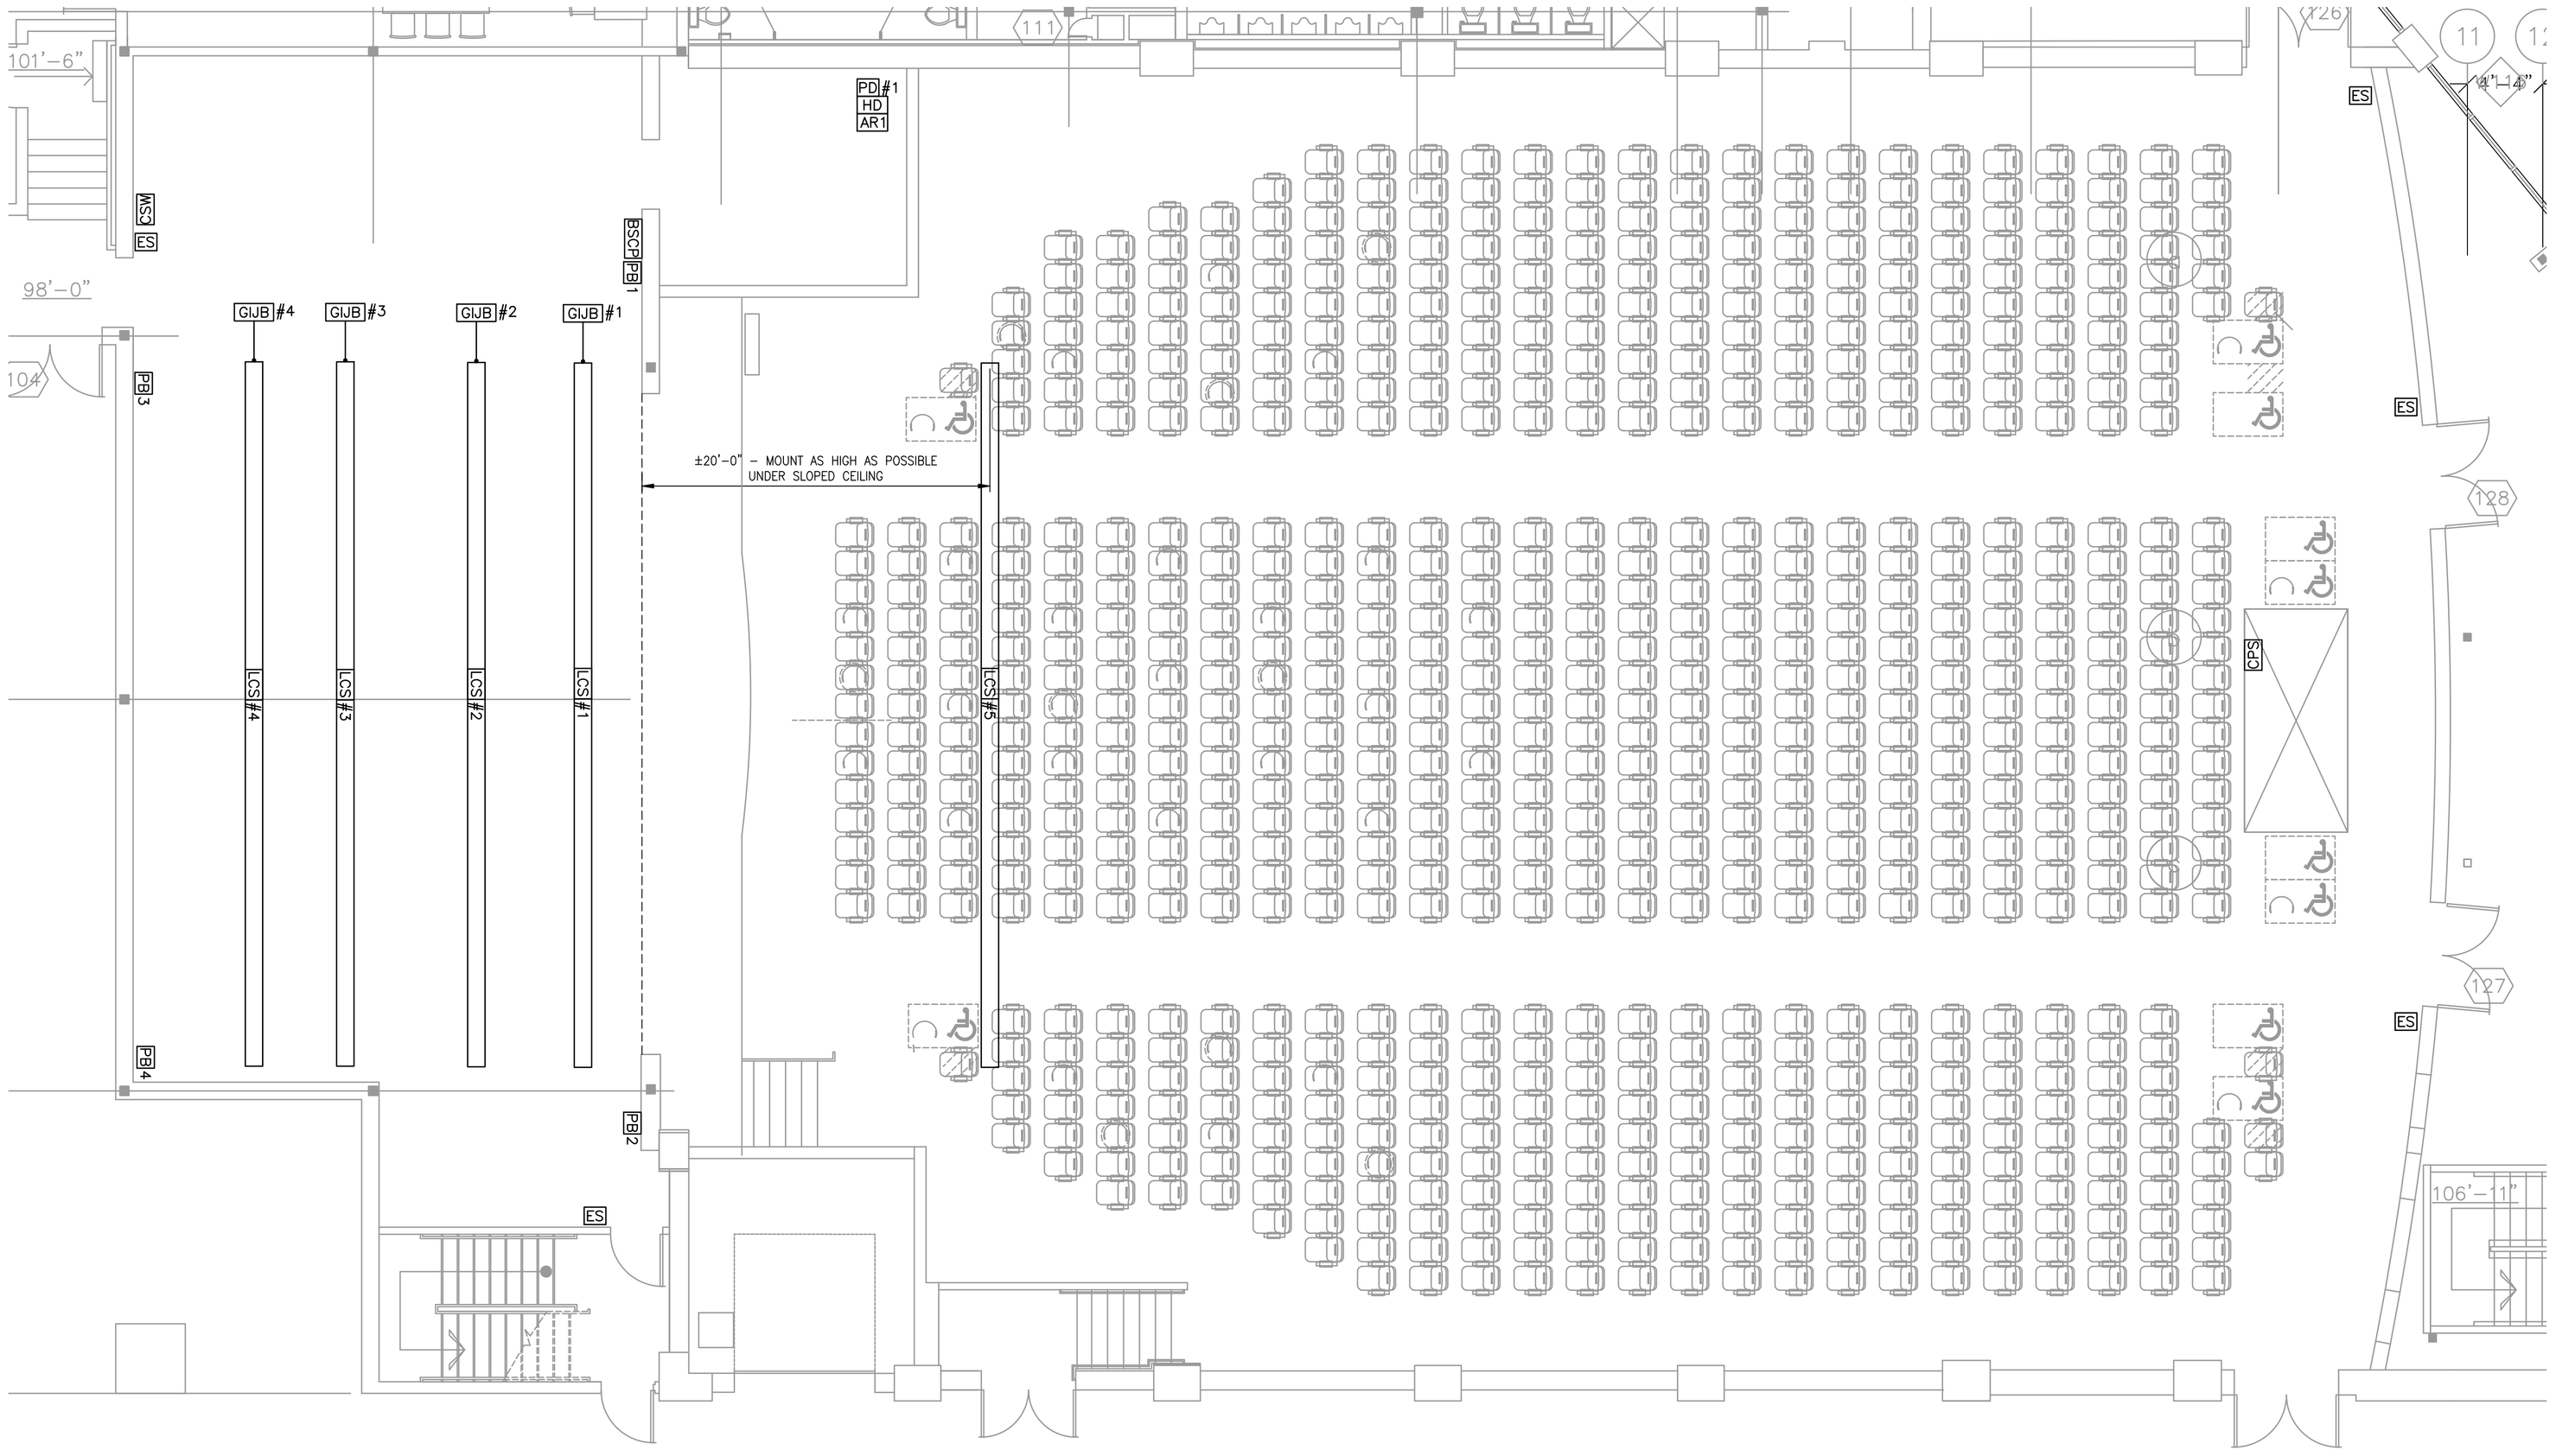

1 / LR-1.0 STAGE LIGHTING SYSTEM DEVICE PLAN

SCALE: 3/16"=1'-0"

DEVICE LEGEND - STAGE LIGHTING
PARK THEATER - CRANSTON, RI

AR1	AUXILLARY RACK 1 - LIGHTING PROVIDED BY STAGE LIGHTING CONTRACTOR, INSTALLED BY ELECTRICAL CONTRACTOR. MOUNT IN DIMMER ROOM WITH TOP OF ENCLOSURE @ 60"AFF.	ES	HOUSE LIGHTING ENTRY STATION ONE GANG 3-1/2" DEEP BOX. MOUNT @ SWITCH HEIGHT.	HD	HOUSE LIGHTING DIMMER RACK PROVIDED BY THEATRICAL LIGHTING CONTRACTOR, INSTALLED BY ELECTRICAL CONTRACTOR. LOCATE IN DIMMER/AMP ROOM, MOUNT AS SHOWN ON PLAN.	PD#	STAGE DIMMER RACK PROVIDED BY THEATRICAL LIGHTING CONTRACTOR, INSTALLED BY ELECTRICAL CONTRACTOR. "#" DENOTES SPECIFIC NAME. LOCATE IN DIMMER/AMP ROOM, MOUNT AS SHOWN ON PLAN.	
BSCP	BACK STAGE CONTROL PANEL PROVIDED BY THEATRICAL LIGHTING CONTRACTOR, INSTALLED BY ELECTRICAL CONTRACTOR. MOUNT TOP OF ENCLOSURE @ + 60" AFF.	GJB#	GRID IRON JUNCTION BOX PROVIDED BY THEATRICAL LIGHTING CONTRACTOR, INSTALLED BY ELECTRICAL CONTRACTOR. MOUNT ON STAGE LEFT LOADING BRIDGE CATWALK HANDRAIL.	LCS#	STAGE LIGHTING CIRCUIT STRIP PROVIDED BY THEATRICAL LIGHTING CONTRACTOR, INSTALLED BY ELECTRICAL CONTRACTOR. "#" DENOTES SPECIFIC NAME. LOCATE LCS# 1-3 ON CATWALK ABOVE AUDIENCE SEATING AREA. LOCATE LCS# 4-8 ON STAGE RIGGING SYSTEM PIPES. SEE RISER PLAN AND CIRCUIT DISTRIBUTION FOR DETAIL.	PB#	STAGE LIGHTING PLUGIN BOX PROVIDED BY THEATRICAL LIGHTING CONTRACTOR. INSTALLED BY ELECTRICAL CONTRACTOR. "#" DENOTES SPECIFIC NAME. MOUNT @ RECEPTACLE HEIGHT.	
CPS	CONSOLE PLUGGING STATION FLUSH MOUNT 3 GANG BOX. MOUNT @ RECEPTACLE HEIGHT BELOW COUNTER IN CONTROL AREA AS SHOWN.					CSW	400A COMPANY SWITCH - MAY BE PREDIVIDED BY EITHER STAGE LIGHTING CONTRACTOR OR ELECTRICAL CONTRACTOR. FINAL INSTALLATION BY ELECTRICAL CONTRACTOR.	

SPECIALTY ENCLOSURES
LOWELL MANUFACTURING
100 INTEGRAL DRIVE
PACIFIC, MO 63069
636-257-3400

THIS DRAWING IS THE PROPERTY OF SCHEU CONSULTING SERVICES AND IS INTENDED FOR USE WITH THIS PROJECT ONLY. IT IS SUBJECT TO REVIEW BY THE PROJECT'S ENGINEER AND IS PROVIDED SOLELY TO COMMUNICATE DESIGN INTENT.

ANY ERRORS, OMISSIONS, OR AMBIGUITIES SHALL NOT RELIEVE ANY CONTRACTOR OF THEIR OBLIGATIONS TO COMPLY WITH APPLICABLE CODES AND REGULATIONS, OR THE PROJECT'S GENERAL CONDITIONS AND SPECIFICATIONS. THE THEATRE EQUIPMENT CONTRACTOR IS SOLELY RESPONSIBLE FOR PROVIDING COMPLETE, SAFE, AND FULLY OPERATIONAL SYSTEMS.

REPRODUCTION, TRANSMISSION OR OTHER USE OF THIS DRAWING WITHOUT THE WRITTEN PERMISSION OF SCHEU CONSULTING SERVICES IS PROHIBITED.

©2008 SCHEU CONSULTING SERVICES, INC.

REVISIONS/ISSUES

NUMBER	DATE	DRAWN	DESCRIPTION

PROJECT AND LOCATION:
PARK THEATER
CRANSTON, RI

CLIENT: APEX CONSTRUCTION SERVICES, LLC

SCHEU CONSULTING SERVICES, INC.
FULL SERVICE THEATRE CONSULTING
310 FALLS BOULEVARD ◆ CHITTENANGO, NY 13037
TEL: 315.510-3365 ◆ FAX: 315.366.2929
WWW.SCHEUCONSULTING.COM

DRAWING TITLE:
AUDITORIUM STAGE
STAGE LIGHTING SYSTEM
DEVICE LOCATIONS

SCALE: AS NOTED	FILE NAME	SCS PROJECT NO.	
DRAWN: PAS			
DATE: 08MAY08	DRAWING NO.	LR-1.0	
CHECKED:			
DATE:			